


NOTES:

1. (3) #4 HOOPS IN BOTTOM SLAB
2. 6X6-6/6 WWM CENTERED IN WALL TOP SECTION
3. #3 HOOP TOP AND BOTTOM OF KNOCKOUTS & #3 VERTICAL @ 12" O.C. IN BOTTOM SECTION
4. CONSEAL CS202 MASTIC TYP. AT JOINTS
5. M.A. INDUSTRIES PS1-PF-DF STEPS @ 16" TYP.
6. HEIGHT CAN VARY BY ADDING BARREL SECTIONS MAX. 12'-0"

GENERAL NOTES

- * Built to ASTM C-478 Specification
- * Concrete shall conform to applicable provisions of ACI_301 and 318. Minimum 28 day compressive strength (f'c) - 5,000 psi
- * Design Loading: AASHTO-H20-44 and Soil Pressure of 120pcf
- * Steel reinforcement: ASTM A615 grade 40, ASTM A-185 Welded Wire Fabric
- * Reinforcement shall be fabricated and placed per ACI Manual of Standard Practice (ACI_315).
- * Concrete cover over reinforcing: Per drawings, min. 1"
- * Keep reinforcement clean and free of dirt, oil, scale. Oil forms prior to placing reinforcement.
- * Basin to bear on bearing soil per construction documents.
- * Backfill around basin per construction documents.

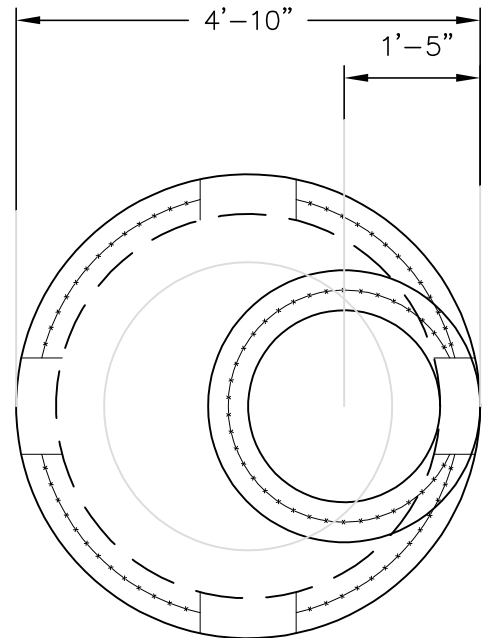

2 TOP VIEW
DW1 SCALE 1/2"=1'-0"

SHEET

48"Ø DRY WELL

DW1

THREE FORKS LUMBER AND READY MIX
THREE FORKS MONTANA

